

ORDINANCE NO. 2020-04-18

AN ORDINANCE AMENDING SECTION 15.01.1410 OF THE AMERICAN FORK CITY CODE RELATING TO DETAILED DRAWINGS FOR THE 1-INCH CULINARY WATER SERVICE CONNECTION AND PROVIDING AN EFFECTIVE DATE FOR THE ORDINANCE.

Whereas, American Fork City has adopted standards for construction;

Whereas, American Fork City has determined there is a need for standards on one-inch culinary water service connections; and

Whereas, the adoption of this ordinance is in the best interest of the City and will promote the public health, safety and welfare of the City.

NOW THEREFORE, be it ordained by the City Council of American Fork, Utah that:


1. Section 15.01.1410 be amended to include the attached 1” culinary water service connection drawing.


EFFECTIVE DATE. This ordinance shall take effect immediately upon its passage and publication as prescribed by law.


PASSED AND ADOPTED BY THE CITY COUNCIL OF AMERICAN FORK, STATE OF UTAH, ON THIS 28 DAY OF APRIL, 2020.


Bradley J. Frost, Mayor

ATTEST:


Terilyn Lurker, City Recorder

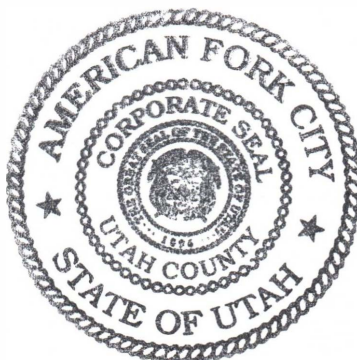

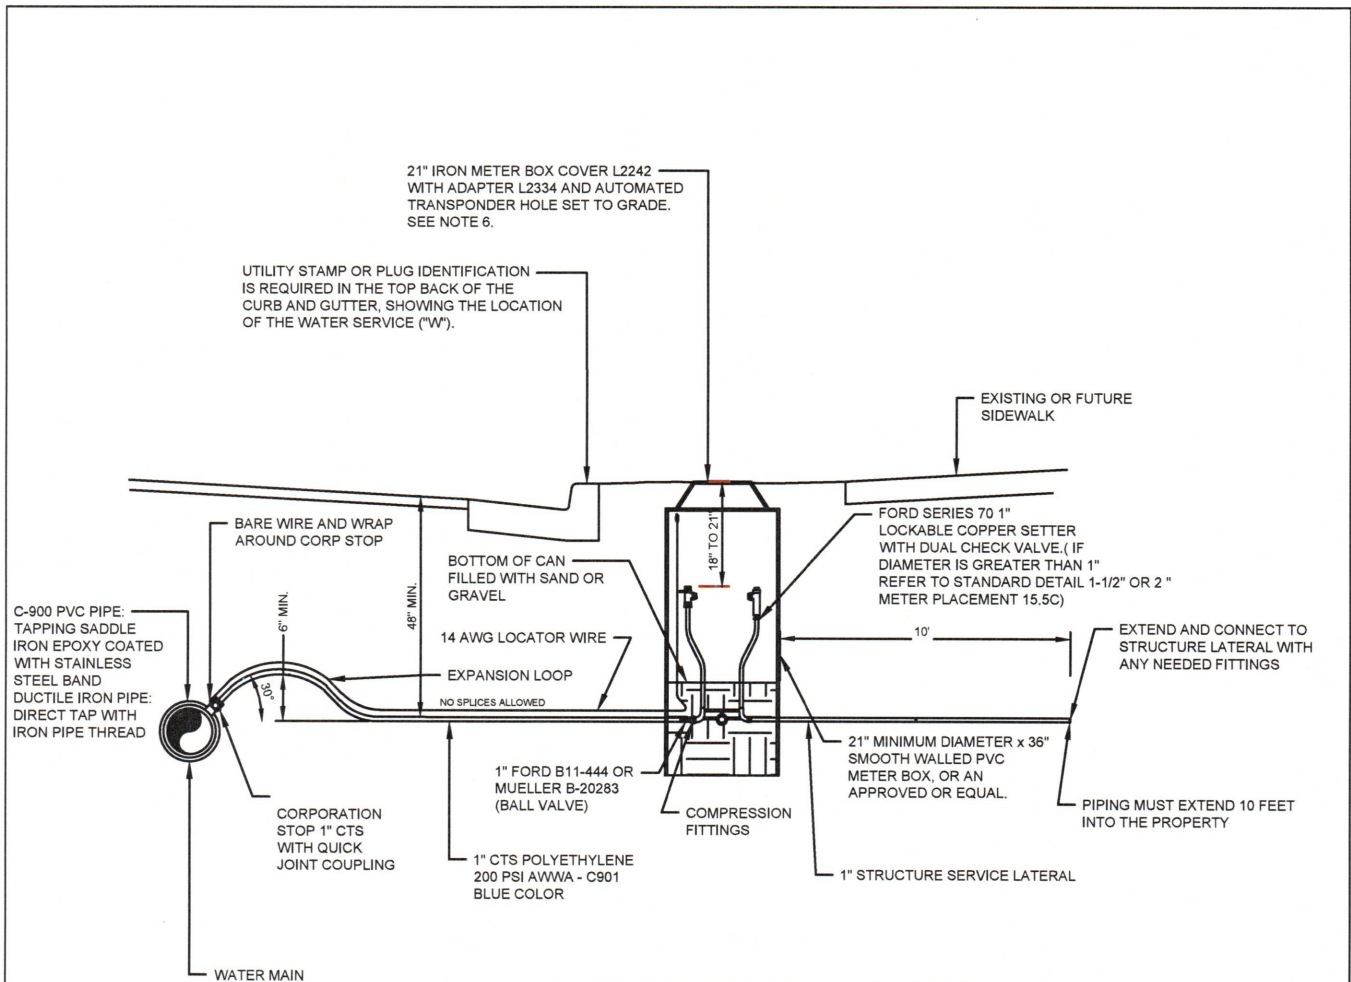

1" CULINARY WATER SERVICE CONNECTION

NOTES:

1. METER BOX, COVER, COPPERSETTER, CORPORATION STOP & SERVICE LINES TO BE FURNISHED AND INSTALLED BY CONTRACTOR, METER IS REQUIRED AND MUST BE PURCHASED BY THE PROPERTY OWNER FROM THE CITY. METER IS PROVIDED AND INSTALLED BY THE CITY.
2. STAINLESS STEEL STIFFENERS ARE REQUIRED ON ALL POLYETHYLENE CONNECTIONS.
3. CULINARY WATER LATERALS THAT ARE LAID PARALLEL TO A SEWER MUST BE LAID AT LEAST 10' (EDGE TO EDGE) FROM ANY EXISTING OR PROPOSED SEWER LATERAL. (PER UTAH CODE R309-550-7)
4. WHERE WATER AND SEWER LATERALS MUST CROSS, WATER LATERAL SHALL BE A MINIMUM OF 18" ABOVE THE SEWER LATERAL AS MEASURED EDGE TO EDGE. (PER UTAH CODE R309-550-7)
5. TEFLON TAPE OR APPROVED EQUAL IS REQUIRED ON ALL THREADED CONNECTIONS.
6. ALL METER BOX LIDS WITHIN CONCRETE SHALL BE D&L SUPPLY MODEL B-5021 (LIGHT TRAFFIC) WITH A RECESSED TRANSPONDER HOLE SET TO GRADE.
7. ALL FITTINGS SHALL BE CTS.
8. SPlicing /REPAIR OF EXISTING POLY PIPE ; MECHANICAL COMPRESSION WITH INTERNAL STIFFENERS ARE REQUIRED. MUST BE APPROVED BY AMERICAN FORK CITY.
9. LATERALS SHALL BE OF ONE CONTINUOUS LENGTH OF PIPE FROM MAIN TO SETTER AND FROM SETTER TO STRUCTURE AND SHALL BE BURIED AT A MINIMUM OF 48" UNLESS APPROVED BY THE CITY ENGINEER.
10. METER CAN SHALL BE INSTALLED AT THE CENTER OF THE PARK STRIP BETWEEN FRONT OF SIDEWALK AND BACK OF CURB.

DRAWN BY NLP	 <p>AMERICAN FORK — 1853 —</p>	AMERICAN FORK CITY PUBLIC WORKS 275 EAST 200 NORTH (801)763-9030	1" CULINARY WATER SERVICE CONNECTION	DRAWING NO	
REVISED ABM					
DATE 9/18/2019.					
SCALE VARIES					15.5