

ORDINANCE NO. 2021-03-16

AN ORDINANCE AMENDING SECTION 15.01.1420 OF THE MUNICIPAL CODE OF AMERICAN FORK CITY, UTAH, RELATED TO FIRE HYDRANTS.

WHEREAS, Chapter 15.01 of the American Fork Municipal Code relates to Development and Construction Standards of American Fork, Utah;

WHEREAS, City Council desires to amend the standards for fire hydrants;

WHEREAS, it is in the best interest and general welfare of residents of American Fork to amend the Code relating to connection standards to require each individually owned unit to be served by a separate connection; and

NOW THEREFORE, be it ordained by the City Council of American Fork, Utah, that:

1. Section 15.01.1420 of the Municipal Code of American Fork City, relating to fire hydrants be amended to include the attached fire hydrants drawings.

EFFECTIVE DATE

This amended ordinance shall take effect immediately upon its passage and publication as prescribed by law.

PASSED AND ADOPTED BY THE CITY COUNCIL OF AMERICAN FORK, STATE OF UTAH, ON THIS 23 DAY OF MARCH 2021.




Bradley J. Frost
American Fork City Mayor

ATTEST:



Terilyn Lurker
City Recorder



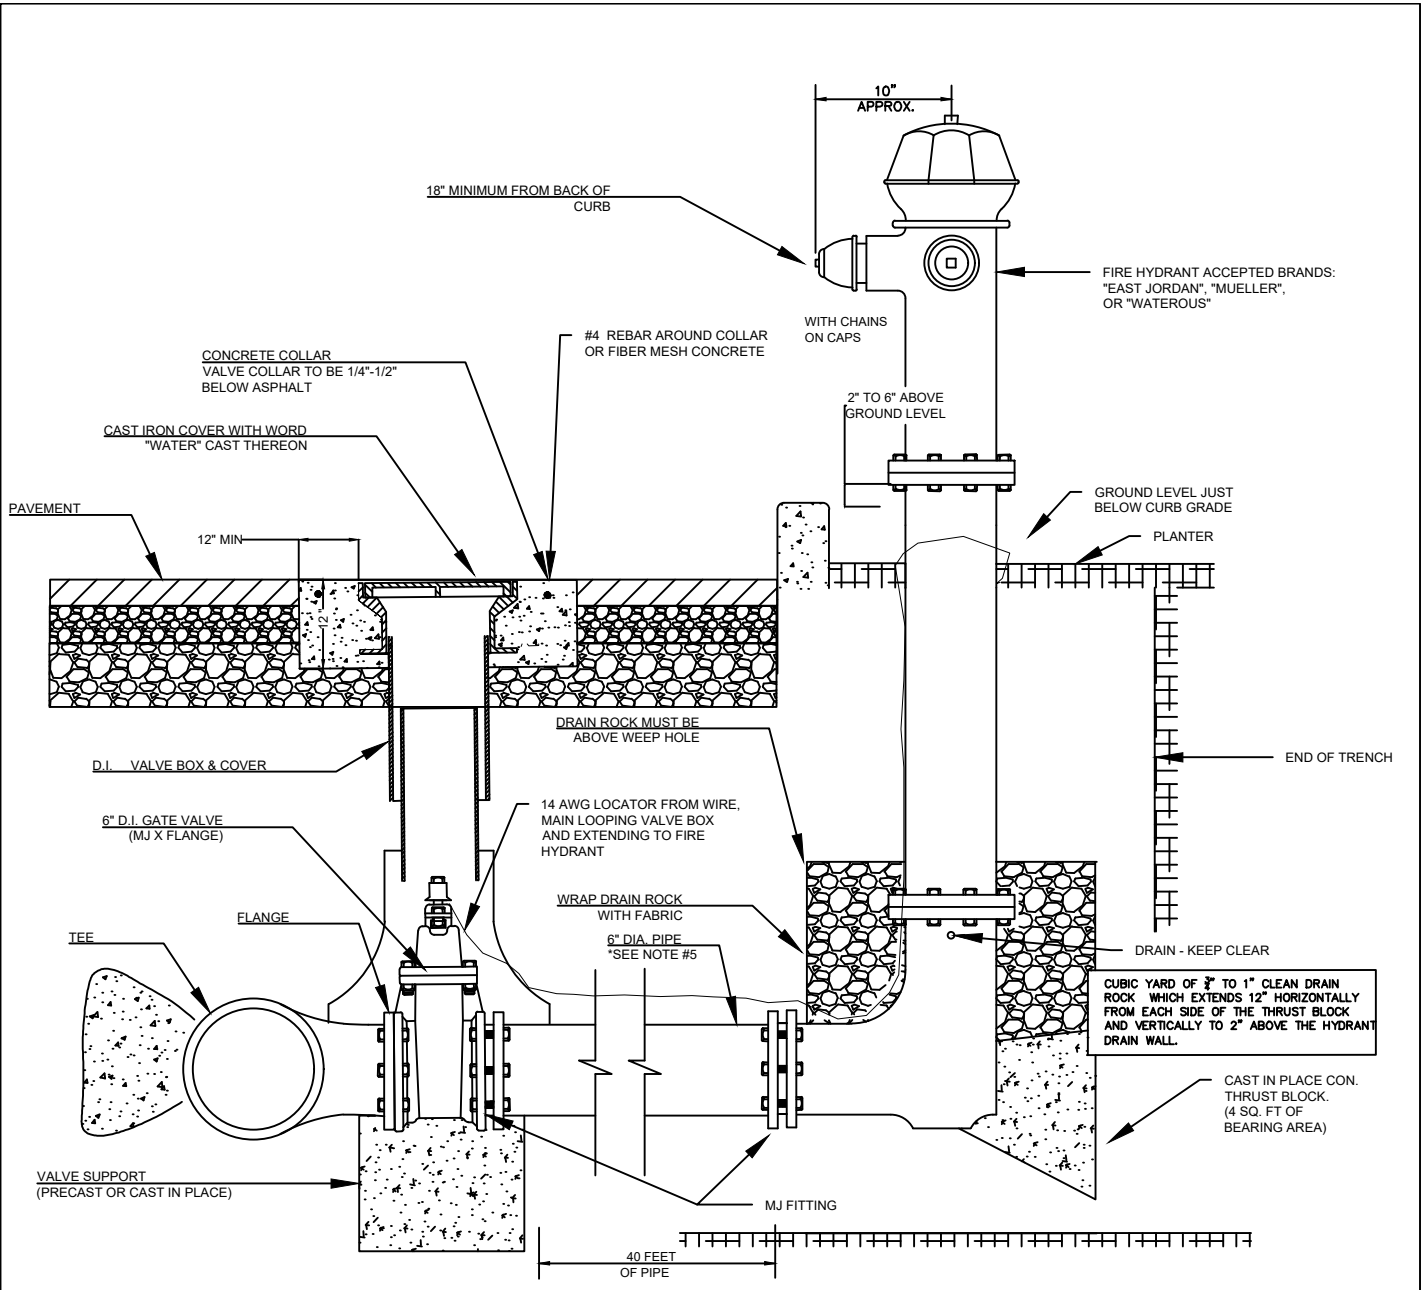

-NTS-

NOTES

1. HYDRANTS THAT ARE TO BE RELOCATED AS CALLED ON THE PLAN VIEW SHALL BE REINSTALLED IN ACCORDANCE WITH THIS DETAIL.
2. ALL GATE VALVES SHALL BE LOCATED AT THE MAIN LINE AS SHOWN ON THIS DETAIL.
3. WHERE EXISTING FITTINGS ARE NOT COMPATIBLE WITH THE NEW MAIN CONSTRUCTION, SUITABLE ADAPTERS OR NEW FITTING SHALL BE USED UPON APPROVAL BY THE AMERICAN FORK CITY ENGINEER.
4. ALL ANCHORS AND BLOCKING TO BEAR PIPE AGAINST UNDISTURBED SOIL.
5. IF LENGTH OF PIPE EXCEEDS 40 FEET, INCREASE DIAMETER TO 8 INCH MINIMUM.
6. POLYETHYLENE ENCASEMENT: ALL DI PIPE AND FITTING SHALL BE INCASED WITH POLYETHYLENE WRAP 8 MILS TO PROTECT FROM BACKFILL BUT IS NOT INTENDED TO BE AIR AND WATERTIGHT.

DRAWN BY ABM	 <p>AMERICAN FORK CITY PUBLIC WORKS 275 EAST 200 NORTH (801)763-3060</p>	STANDARD DETAIL FOR	DRAWING NO.	
REVISED KKS		FIRE HYDRANT	15.6	
DATE 1/13/2021				
SCALE NTS				